

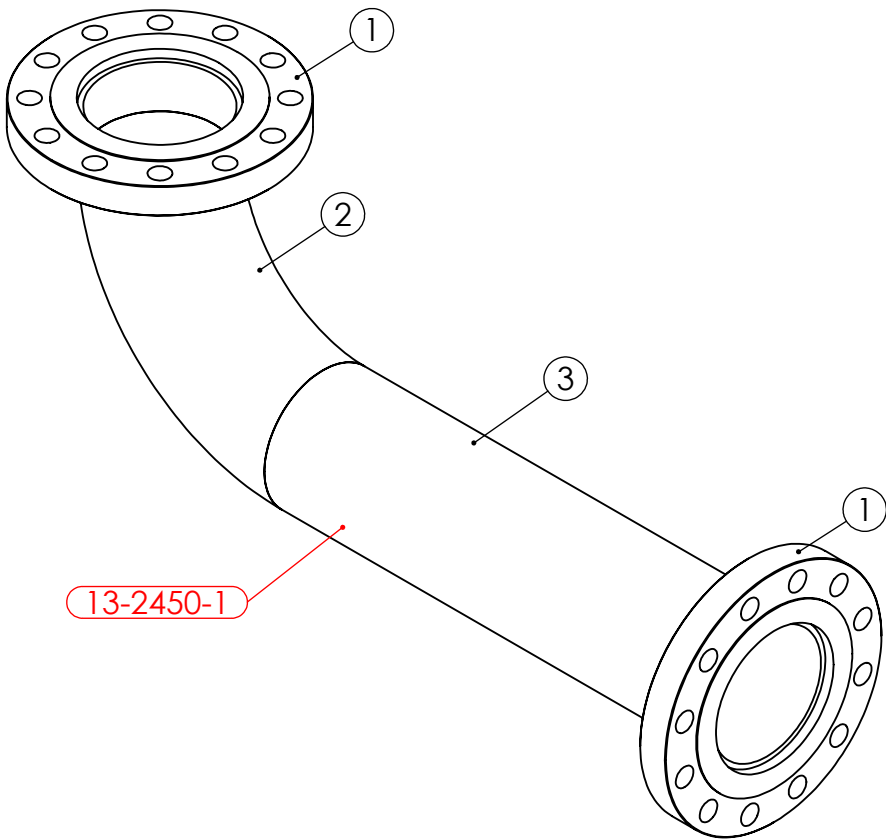
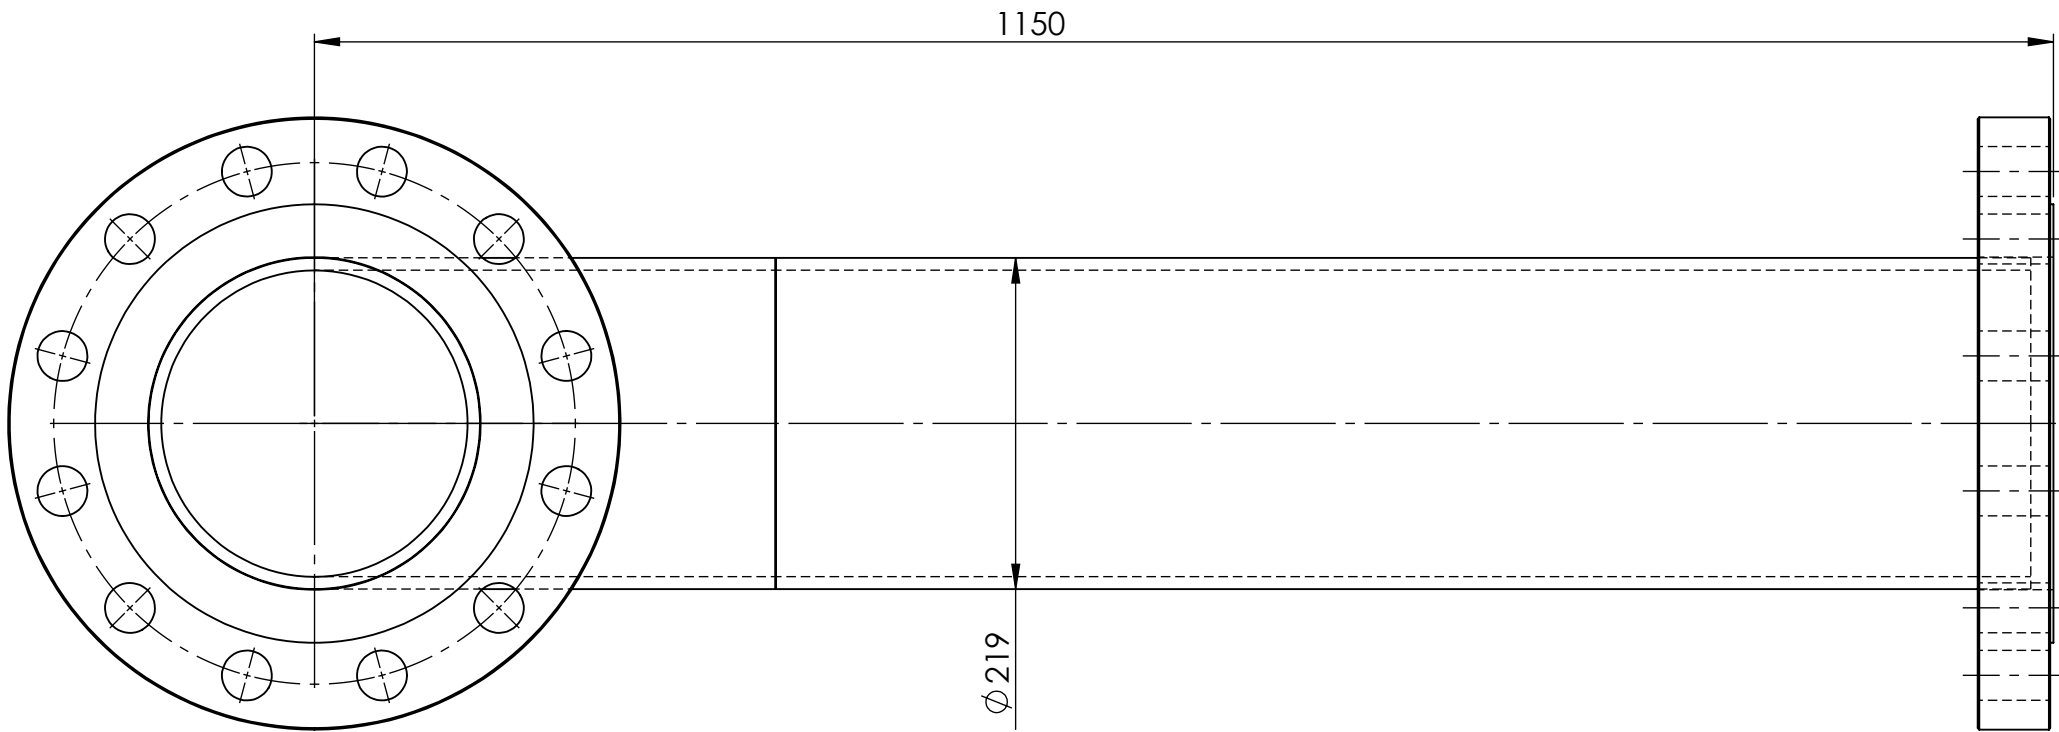


| ITEM | DRAWING No           | DESCRIPTION                             | QTY. | WEIGHT |
|------|----------------------|-----------------------------------------|------|--------|
| 1    | OEM-200-JIS40-P-316L | 200NB JIS 40K PLATE FLANGE 316L S/S     | 2    | 31.37  |
| 2    | OEM-200-LR-40-316L   | 200NB LONG RADIUS BEND SHED 40 316L S/S | 1    | 20.8   |
| 3    | 14-2450-1-1          | 200NB PIPE SHED 40 316L                 | 1    | 45.20  |

RED EYE  
QR CODE  
AREA

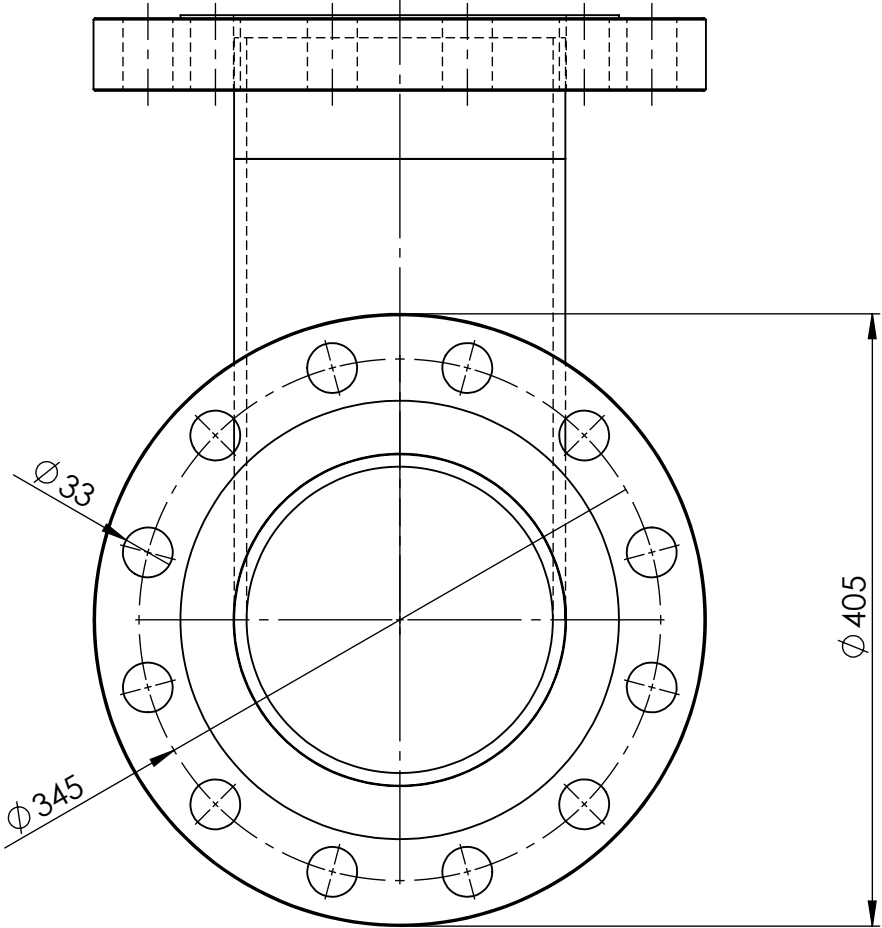

PIPE LABEL - 13-2450-1

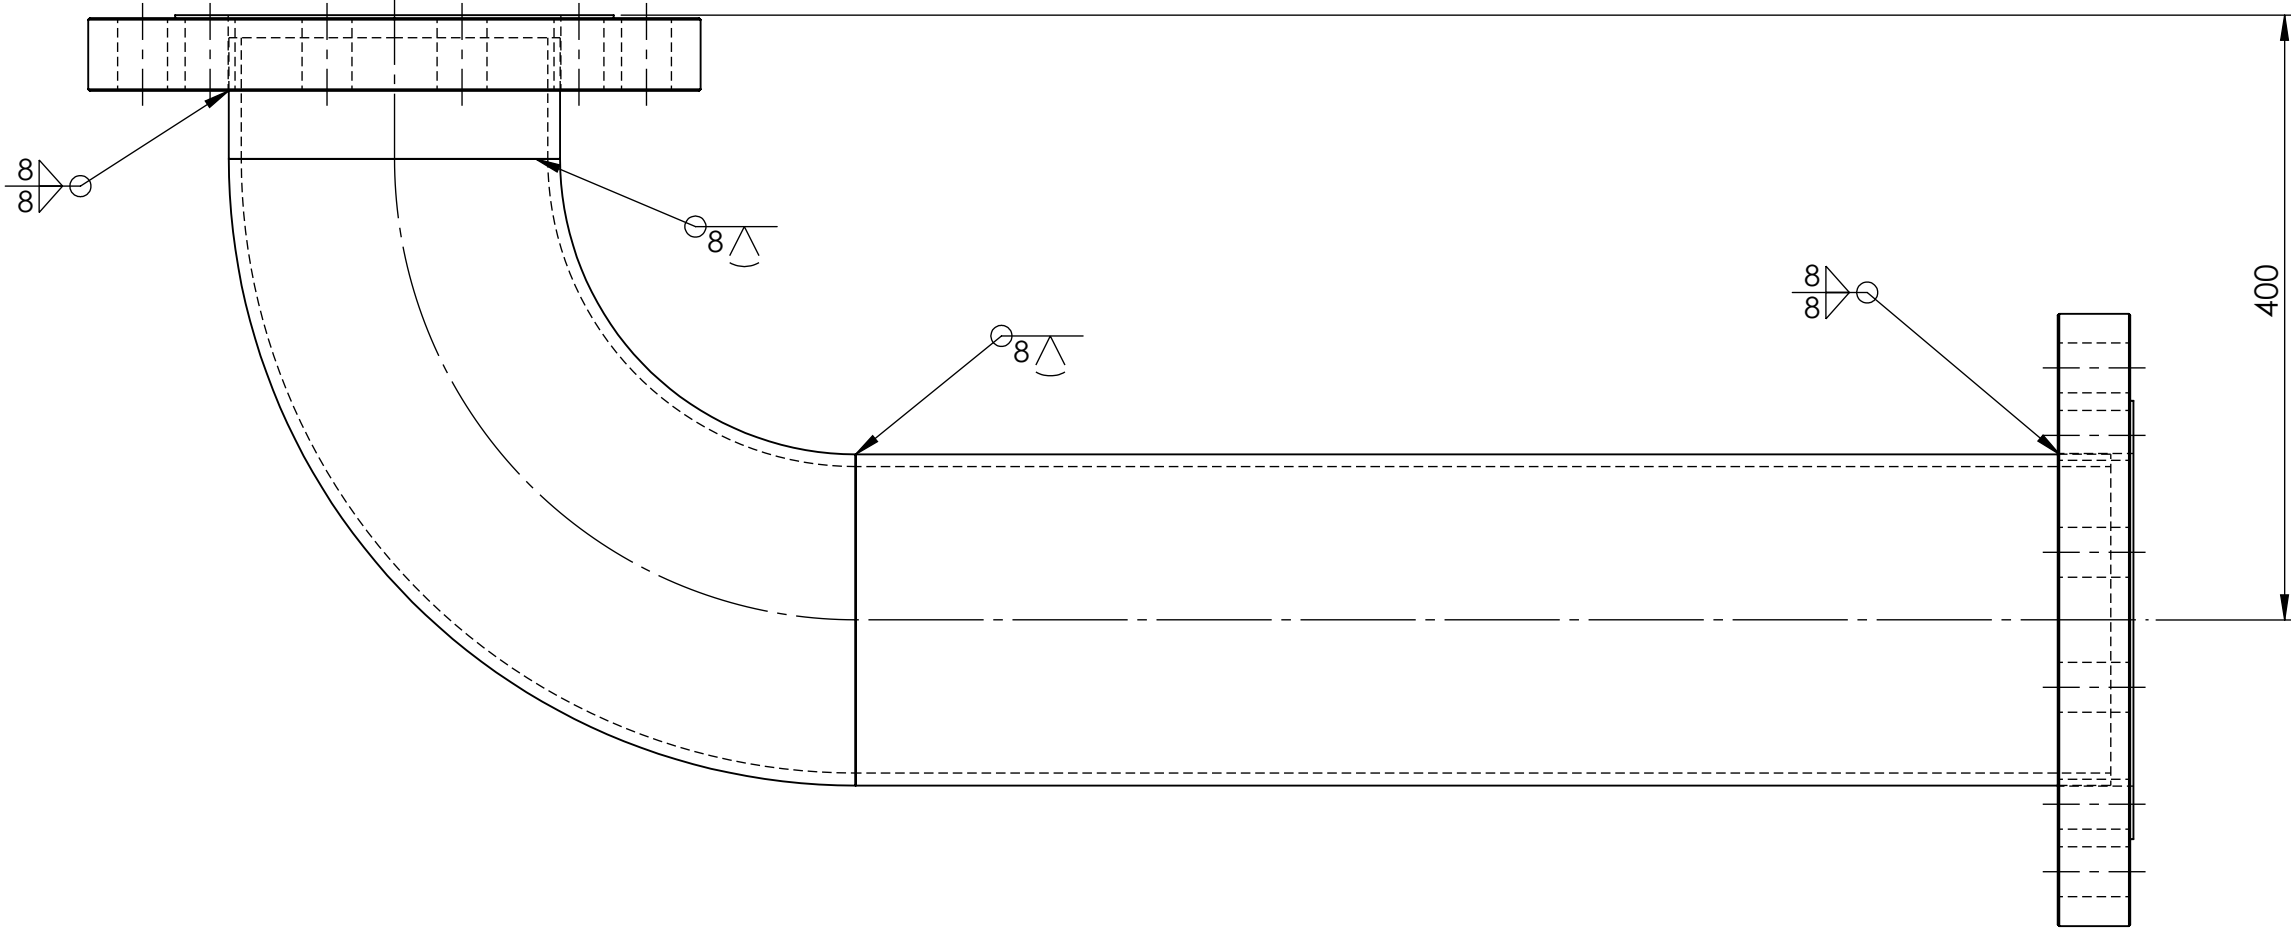

ISSUED FOR CONSTRUCTION 27/9/25

- NOTES:**
- FLANGES ARE TO BE WELDED & INSPECTED IN ACCORDANCE WITH SHL-MEC-119
  - ALL PIPEWORK SHALLBE PRESSURE TESTED & CLEANED INTERNALLY AS PER SHL-MEC-119
  - PIPEWORK SHALL BE SETUP IN WORKSHOP AS PER SITE INSTALLATION PRIOR TO WELDING NEW FLANGES

PIPE BETWEEN VALVE 2450 & 2451 WEIGHT - 123.11 kg

|     |                |             |                                                                                                                                                                    |                                   |                 |                                                                                       |            |     |              |
|-----|----------------|-------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------|-----------------|---------------------------------------------------------------------------------------|------------|-----|--------------|
|     |                |             | UNLESS OTHERWISE SPECIFIED:<br>TOLERANCES: MACHINE + / - 0.25mm<br>FABRICATION + / - 1.0 mm                                                                        | DRAWN<br>N DE BRUYN<br>17/09/2025 | DRAWING CHECKED |  |            |     |              |
|     |                |             | THIS DRG SUPPLIED BY<br><br>14 Waratah St, TUMUT NSW 2720<br>Ph: 02 6947 4039 | DESIGNED                          | DESIGN CHECKED  | M2 POWER STATION UNIT 13<br>PIPE BETWEEN VALVLE 2450 & 2451                           |            |     |              |
|     |                |             |                                                                                                                                                                    | SCALE 1:5<br>WORK ORDER No        | APPROVED        |                                                                                       |            |     |              |
| REV | NAME<br>& DATE | DESCRIPTION | DRAWING No.<br>13-2450-1                                                                                                                                           | REV:                              | SECTION No/KKS  | A2 SHEET<br>SIZE                                                                      | SMA-DRG-NO | REV | SHEET 1 OF 1 |